


EMISSION IMPACTS OF WIND POWER



Design and Operation of Power Systems with

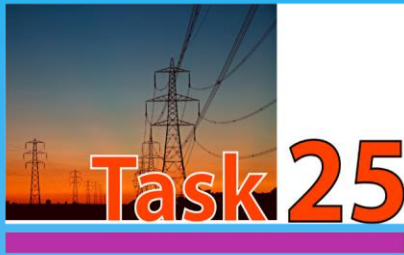

Wind energy will displace fuel consumed in other power plants and thereby reduce emissions. The fact that wind energy will also increase balancing needs has raised concern about the less-efficient use of other power plants due to cycling up and down to balance the system. However, studies show that emissions due to increased cycling of power plants are small compared to the benefits of reducing their overall generation and fuel use.

How does wind power reduce emissions?

Wind power is a renewable electricity generation source that does not emit CO₂ in operation. It has very low life cycle CO₂ emissions when compared with fossil fuelled generation. When wind power is generated it will displace generation from power plants, reducing their fuel use and emissions of CO₂, NO_x, SO_x, and particulates. What power plant generation and fuel will be displaced depends on the cost structure of operating power

plants, as well as timing. During each hour, the generation that has most expensive operational costs will be reduced, usually fossil fueled generation. If the fuel displaced is coal, the emission benefits are greater than when displacing natural gas. Examples of studies showing the emission reductions of wind power can be seen in Figure 1.

Does wind power variability cause extra emissions?

At high levels of wind generation, fuel-consuming generators will experience steeper ramps and will be starting up and shutting down more often. This is to respond

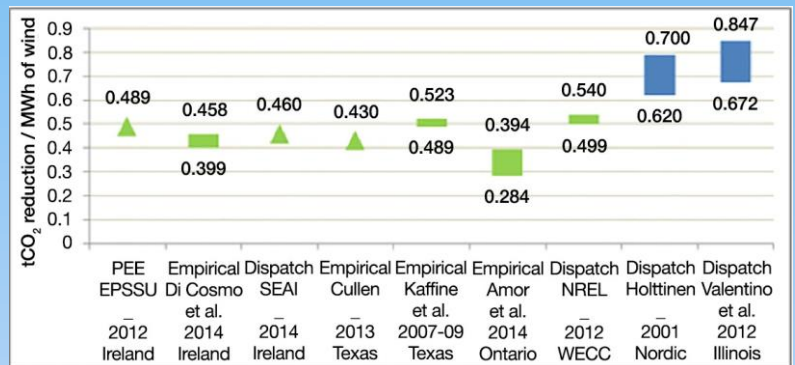


Figure 1. Examples of wind power impact on emission reductions, as g of CO₂ per kWh wind power generated. The green ones are from power systems where wind power replaced mostly gas-fired generation and the blue ones where mostly coal-fired generation is replaced (Source: Holttinen et al., 2014)

to changing dispatch orders to compensate for total fluctuation in system - variation in wind generation and demand. When fossil fuel power plants start up, ramp output up or down, or operate at less than full load, they are less efficient in fuel use than when they run continuously at full load. This results in more CO₂ and other emissions.

Detailed studies have shown that even in power systems with large amounts of wind power, extra emissions from balancing needs are not much. The main impact of replacing coal and gas generated electricity and reducing fuel use and emissions is order of magnitude greater than increased emissions from cycling the power plants.

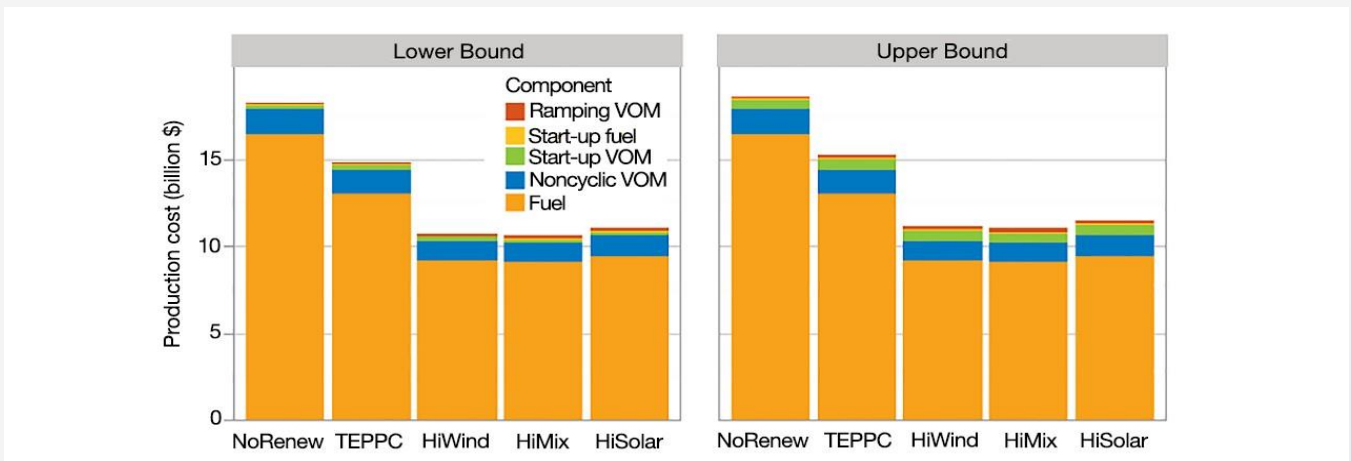


Figure 2. Most of the operation costs and emissions result from fuel use. Ramping and start-ups present less than 1% share of the costs over a year, even with a high share of variable renewables. Example of simulated Western U.S. operational costs from one year, with up to 33% share of wind and solar (Source: Lew, et al., 2013).

For example, providing 33% of annual electricity needs with wind and solar energy, balancing related emissions are less than 2% of the emission reductions from decreased fuel use. (Source: Lew et al., 2013) (Figure 2 and 3)

	Emission Reduction Due to Renewables	Cycling Impact
CO ₂	260–300 billion lbs 29% – 34%	Negligible Impact
NO _x	170–230 million lbs 16% – 22%	3–4 million lbs
SO ₂	80–140 million lbs 14% – 24%	3–4 million lbs

Figure 3. The increase in plant emissions from cycling to accommodate variable renewables is very low compared to the overall reduction in CO₂, NO_x, and SO₂ due to adding renewables. (Source: WWSIS2, 2013) (1 million lbs = .45 million Kg)

How can operators ensure enough flexibility and lower extra emissions from balancing power systems with wind power?

When anticipating larger shares of wind power in a power system, it will be important to increase the flexibility of new fossil fuelled power plants. Increased flexibility can decrease the operational costs and emissions of the overall power system because it provides more options for balancing. Flexibility can be shared with neighbouring regions through the use of interconnecting transmission (trading electricity). Another new source of flexibility is offered by the consumer, called demand response.

Associated publications

Holttinen, H. et al. (2016) **Design and operation of power systems with large amounts of wind power**. Final summary report, IEA WIND Task 25, Phase three 2012–2014. <http://www.vtt.fi/inf/pdf/technology/2016/T268.pdf>

Lew, D., et al. (2013) **The Western Wind and Solar Integration Study Phase 2**. NREL/TP-5500-55588. Golden, CO: National Renewable Energy Laboratory. Available at www.osti.gov/scitech/servlets/purl/1095399

SEAI (2014) **Quantifying Ireland’s Fuel and CO₂ Emissions Savings from Renewable Electricity in 2012**. Available at www.seai.ie/News/Events/Press_Releases/2014/245m-of-fossil-fuel-savings-from-use-of-renewable-electricity-in-2012.html

More information

This Fact Sheet draws from the work of IEA Wind Task 25—a research collaboration among 18 countries. The vision is to provide information to facilitate the highest economically feasible wind energy share within electricity power systems worldwide. IEA Wind Task 25 works on analysing and further developing the methodology to assess the impact of wind power on power systems.

See our website at <https://community.ieawind.org/task25>

See also other fact sheets

- [Wind Integration Issues Fact Sheet](#)
- [Storage Needs and Wind Power Fact Sheet](#)
- [Balancing Power Systems with Wind Power](#)